

Vesivaroittimet
(SLØYFE 2)



Kärkkitiedot
YLEINEN PALO
NO NO

(viivästetty 30s)

Palovaroittimet
(SLØYFE 1)

Seuraaville
ilmaisimille

Lämpölankea VD 068
tai kärkitieto muista
paloyksiköistä (NO)

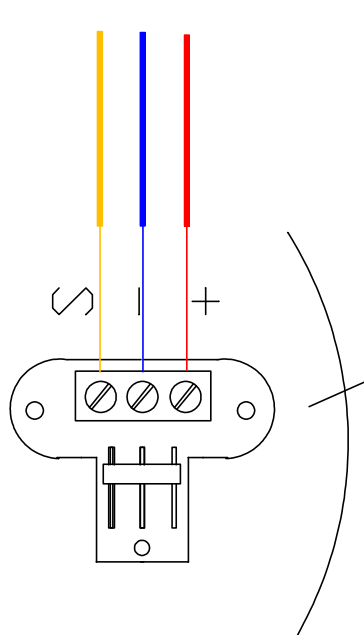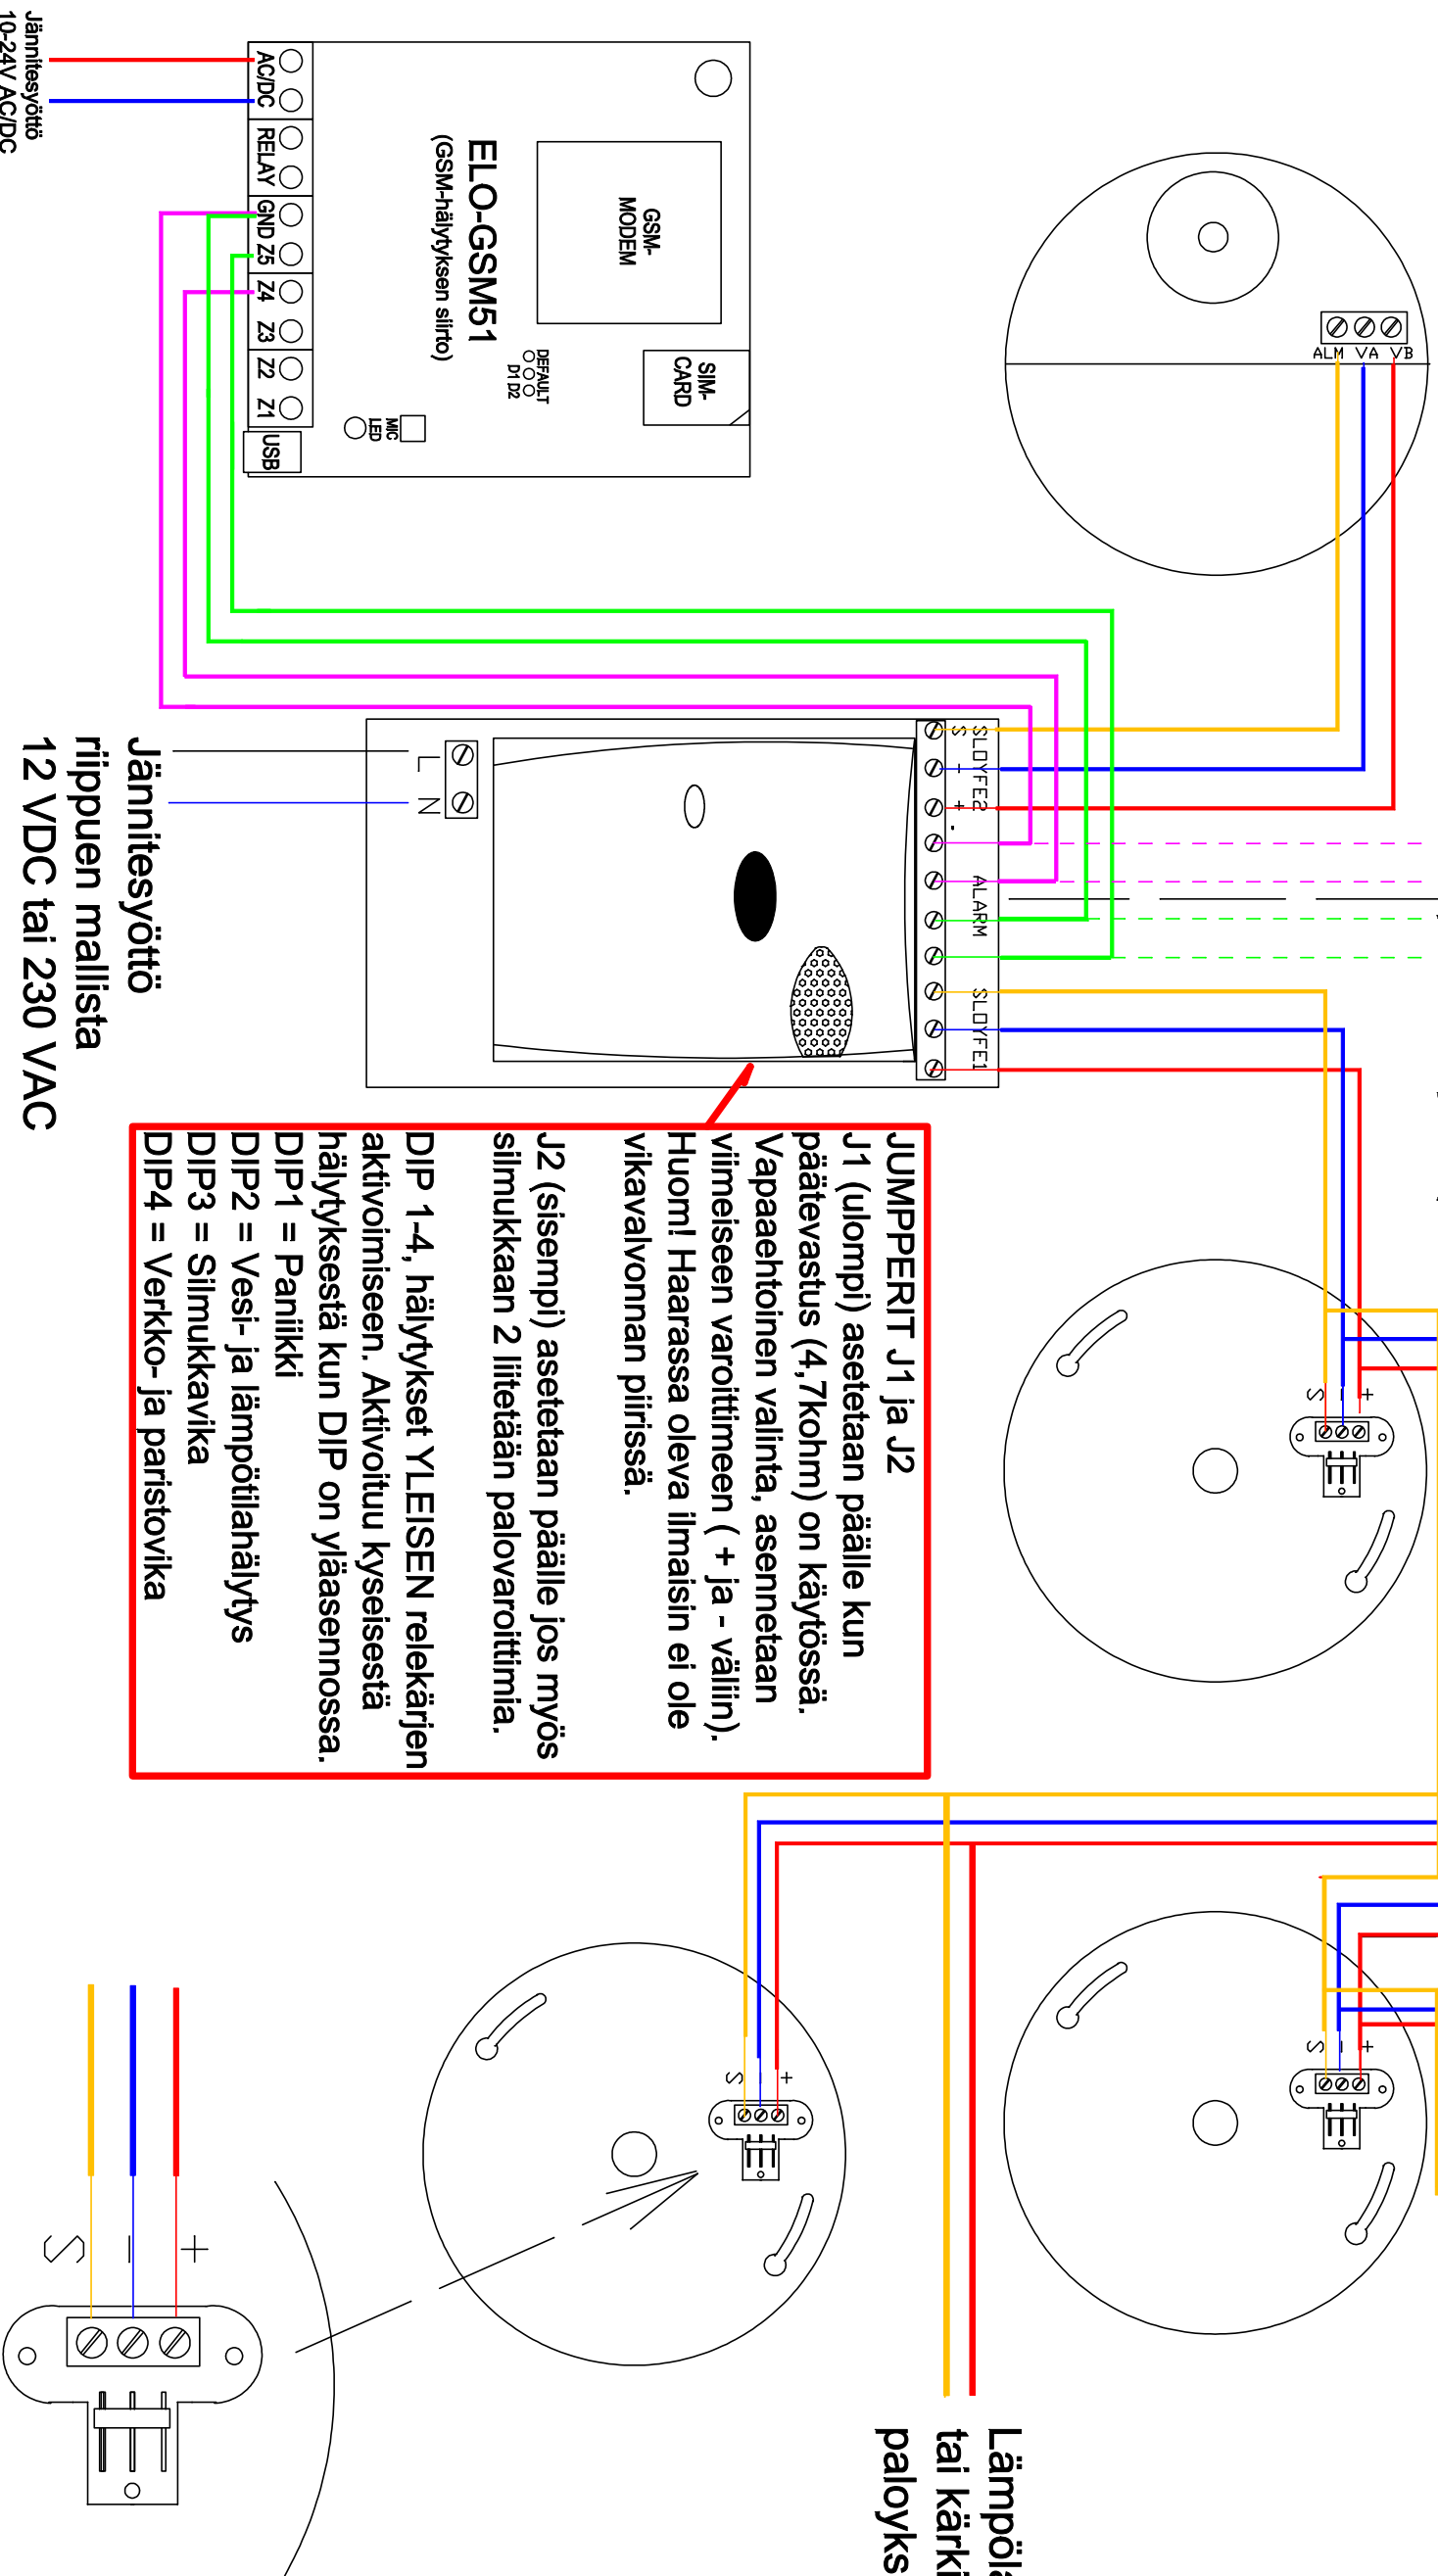

Jännitesyöttö
riippuen mallista
12 VDC tai 230 VAC



ELOTREC

Lapväärtintie 702

64300 LAPVÄÄRTTI

Puh. 06 2228 401

www.elotec.com

Otsikko

Jubilee kytkentäkaavio

Pvm: 16.2.2012

Sivu 1

Sivu ja 1

Muutos SCHEMOR\JUBILEE
\JUBILEE_ELD-GSM

Työnro.

Jubilee

Piirt.

P.K

Piirro.

Hyv.



ELOTEC

MANUFACTURERS DECLARATION OF CONFORMITY

Product identification:

Model/type: Alarm Panel: Jubilee 8-/ 15-/ 12V,
To be used with: Elotec EI 103 J – EO 103 J (smoke detectors)
VA 100 J (water detector).

Manufacturer:

Elotec AS
Industriveien S. 1
7340 Oppdal
Norway

EU Representative:

Elotec AS
Industriveien S. 1
7340 Oppdal
Norway

Applied harmonized standards:

Safety: EN 60065, sixth edition
EMC: EN 61000-6-3 ;2001, EN 50130-4 :1995 +A1:1998
Detectors: EN 14604:2005 (EI 103 J and EO 103 J)

Test report reference: 18358/ 17059 Nemko

Detector certificate: KM 500648, BSi

CE-marking affixed: 2004 (first time)

We declare under our sole responsibility that this product is in conformity with Directives 73/23/EEC (LVD) and 89/336/EEC (EMC) based on test results using harmonized standards in according with the Directives mentioned.

Oppdal 23. February 2005

Jan Kleven
Managing Director / CEO

**ELOTEC AS, Industriveien S. 1
7340 Oppdal, NORWAY
Phone: +47-72 42 49 00
Fax: +47-72 42 49 09**

Enterprise no.: NO 864 602 452 MVA

**e-mail: info@elotec.no
URL: http://www.elotec.com**